
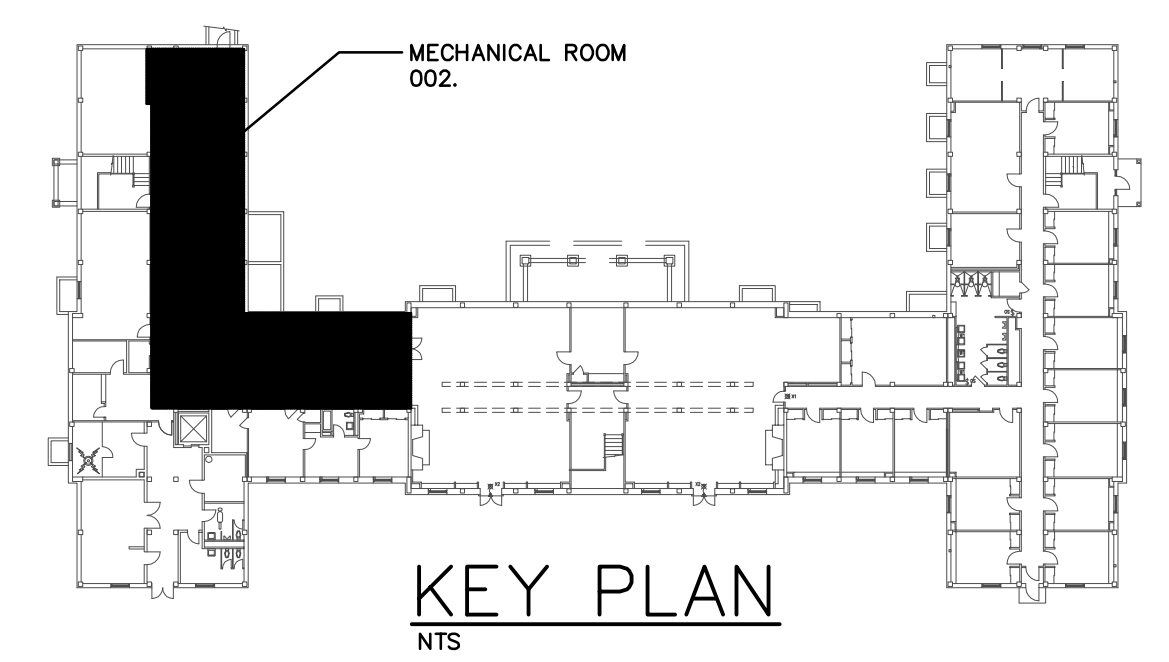


CODED NOTES

1. EXISTING 2 1/2" HEATING WATER SUPPLY AND RETURN PIPING SERVING EXISTING AHU-1 TO BE REMOVED.
2. EXISTING 3-WAY DUAL TEMPERATURE CONTROL VALVE TO REMAIN.
3. EXISTING 2 1/2" CHILLED WATER PIPING TO BE REMOVED.

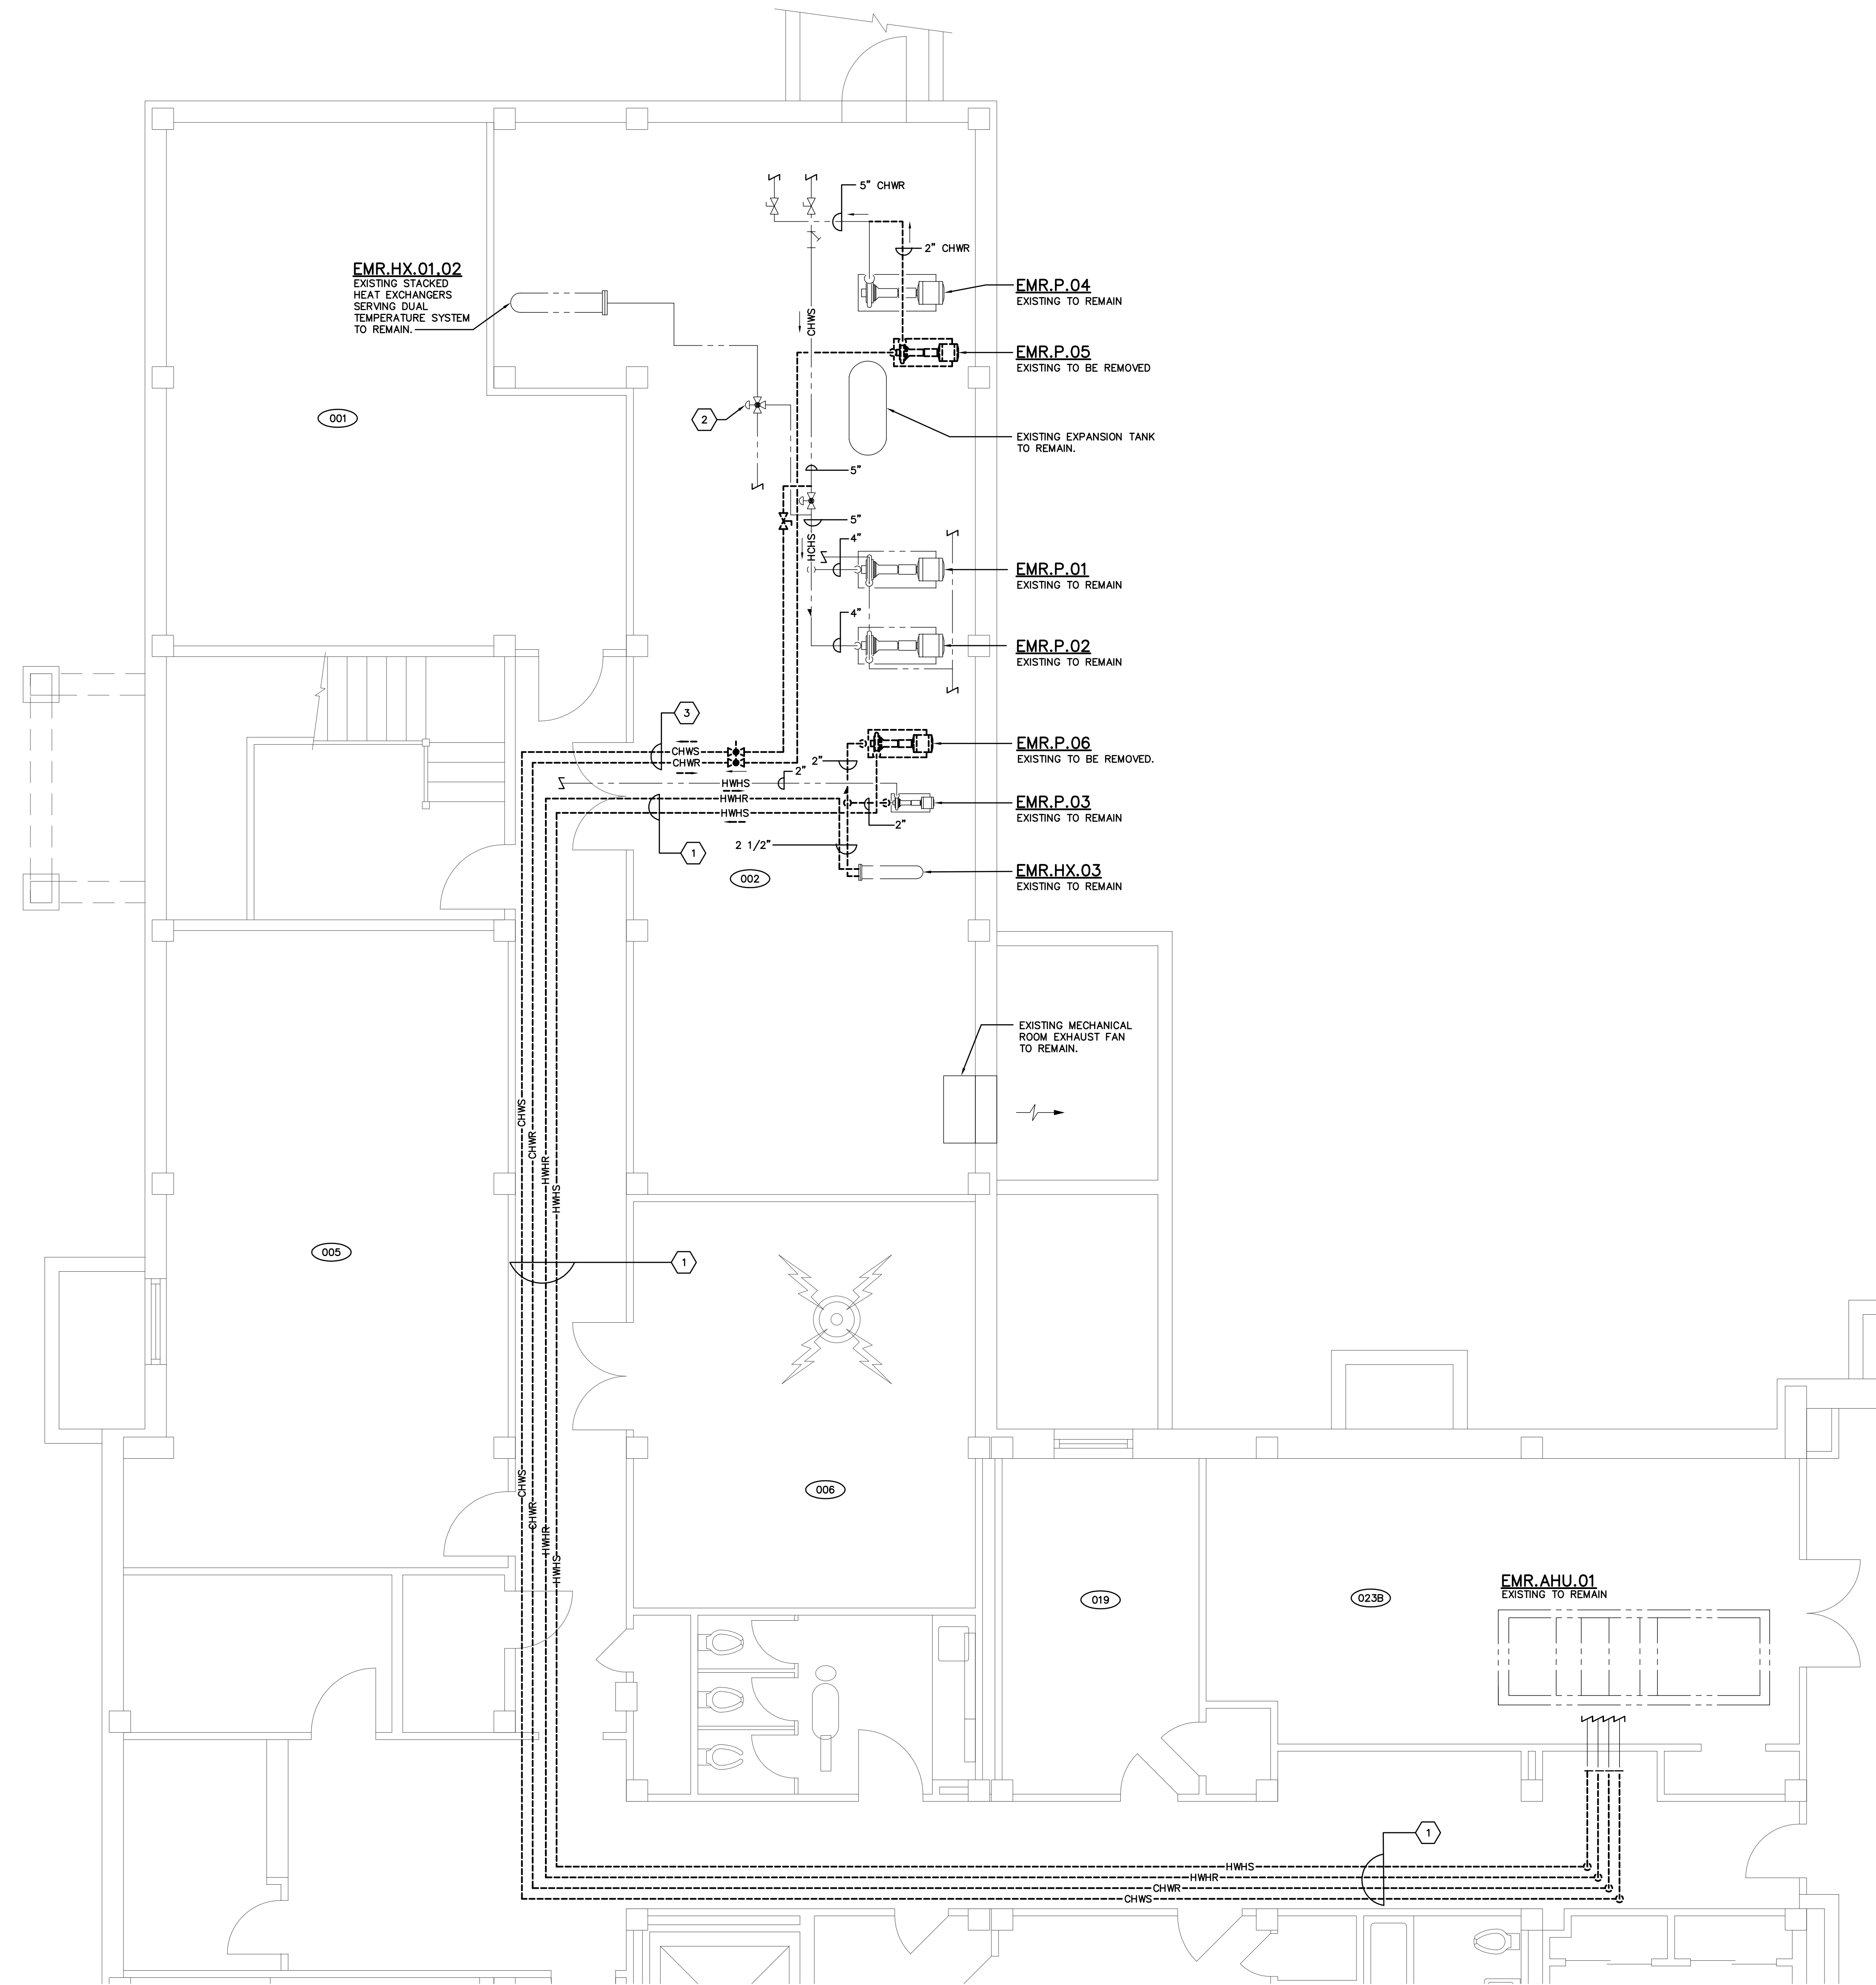

ENLARGED GROUND FLOOR MECHANICAL ROOM DEMOLITION PLAN
SCALE: 1/4" = 1'-0"

NEW SHEET

DATE	DESCRIPTION
3-24-22	ADDENDUM 2
3-4-22	ISSUED FOR BID AND PERMIT

H-200-21380.DWG
ASSOCIATE ENGINEER
PRATER Engineering Associates, Inc.
6130 Wilcox Road
Dublin, Ohio 43016
(614) 766 4886
FAX: (614) 766 2354

SEAL
STATE OF OHIO
TIM PRATER
E-51932
03/04/2022

MIAMI UNIVERSITY
EMERSON HALL
VENTILATION IMPROVEMENTS

PREPARED FOR
MIAMI UNIVERSITY
PHYSICAL FACILITIES DEPARTMENT
OXFORD, OH

PREPARED BY
PRATER ENGINEERING ASSOCIATES
6130 WILCOX ROAD; DUBLIN, OHIO 43016

SHEET TITLE ENLARGED GROUND FLOOR MECHANICAL ROOM DEMOLITION PLAN	SHEET NO. H-200
SCALE AS NOTED	DATE 03/04/2022
DESIGNED BY ARP	CHECKED BY TP